


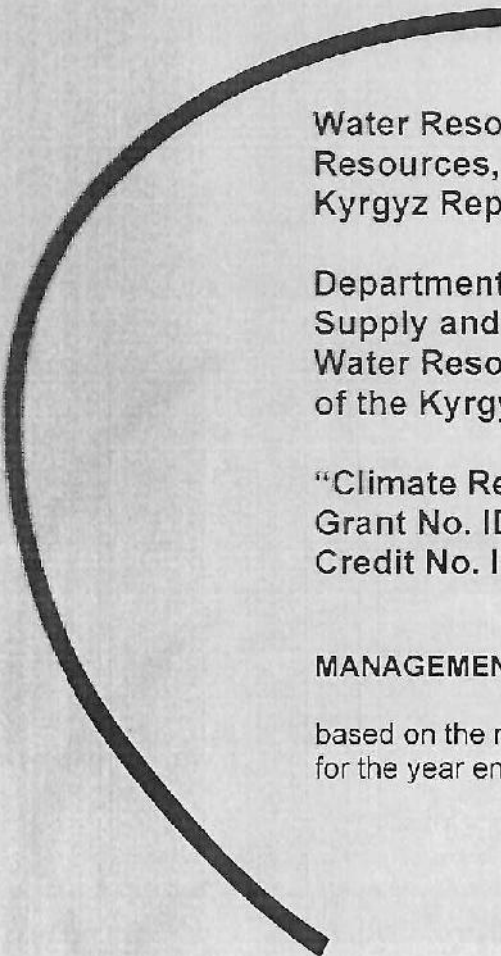

**Water Resources Service under the Ministry of Water
Resources, Agriculture and Processing Industry of the
Kyrgyz Republic,**

**Department for the Development of Drinking Water
Supply and Wastewater Disposal under the Ministry of
Water Resources, Agriculture and Processing Industry
of the Kyrgyz Republic**

**“Climate Resilient Water Services Project”,
Grant No. IDA E009-KG,
Credit No. IDA 7081-KG**

MANAGEMENT LETTER

**based on the results of audit of the project financial statements
for the year ended December 31, 2025**

To the Management of the "Climate Resilient Water Services Project"
Grant No. IDA E009-KG, Credit No. IDA 7081-KG;

Dear Sirs and Madams,


In planning and performing our audit of the project financial statements of the "Climate Resilient Water Services Project" (hereinafter – the "Project") for the year ended December 31, 2025, we considered the internal control structure in order to determine our audit procedures for the purpose of expressing an opinion on the project financial statements, but not to provide assurance on the internal control structure.

In connection therewith, we submit this letter containing our comments, observations, and recommendations concerning the internal control structure and certain accounting, administrative and operating matters, which resulted from our audit of the project financial statements for the year ended December 31, 2025. Definition of the term "internal control structure" used in this letter is set in Appendix A.

This letter is intended solely for the information of, and use by the management of the Project and should not be used by others. We are not responsible for providing this letter to third parties as it was not prepared and intended for their use. This letter should not be given to third parties without prior written consent.

We would like to thank the management and personnel of the Project for their assistance and co-operation during the audit. We acknowledge that the Project has applied efforts to develop and strengthen its planning processes and internal control system.

Sincerely yours,



Certified accountant, FCCA (United Kingdom)

Individual auditor registration number 11152 dated November 16, 2023.

Registered in the Unified state register of auditors, audit organizations, and professional audit associations.

Audit Partner,

Director, Baker Tilly Bishkek LLC

Baker Tilly Bishkek LLC is registered in the "Register of audit organizations admitted for audit of public interest entities and large entrepreneurship entities" of the Unified state register of auditors, audit organizations, professional audit associations. Individual registration number 2101510 dated August 9, 2023

June 12, 2026

Bishkek, the Kyrgyz Republic

"CLIMATE RESILIENT WATER SERVICES PROJECT"
GRANT NO. IDA E009-KG, CREDIT NO. IDA 7081-KG

CONTENT

INTRODUCTION	3
STATUS ACCORDING TO THE RECOMMENDATIONS OF THE PREVIOUS YEAR.....	4
1. Tender documentation (recurring)	4
APPENDIX A	5

"CLIMATE RESILIENT WATER SERVICES PROJECT"
GRANT NO. IDA E009-KG, CREDIT NO. IDA 7081-KG

INTRODUCTION

This letter highlights our observations and recommendations we believe warrant the project "Climate Resilient Water Services Project", Grant No. IDA E009-KG and Credit No. IDA 7081-KG (the "Project"), management's attention and would facilitate improved effectiveness and efficiency of the Project's operations. Certain comments made relate to situations, which warrant immediate attention, while others relate to enhancements of policies and practices and should be addressed according to their perceived significance. The management should prioritize the observations and implementation of the recommendations accordingly. Although the Project has improved some of its internal control procedures, we still believe that there are certain areas where further improvement is necessary. This letter includes a summary of our recommendations.

General presentation – classification of comments and recommendations

High Priority	These risks are significant for the Project, so they require immediate attention from the management to determine any effects to date, an agreed program for a prompt resolution and ensure that they will not recur in the future.
Medium Priority	These risks do not necessarily require immediate attention, but must be managed in a timely manner. In addition, they relate to activities that (currently) are not material but may be material when these activities are developed.
Low Priority	When there is a deficiency, but there is a compensatory control, while not perfect, provides a degree of assurance that, the Project will not have a material loss.

STATUS ACCORDING TO THE RECOMMENDATIONS OF THE PREVIOUS YEAR

1. Tender documentation (recurring)

Priority	Medium
Observations	During the audit procedures conducted to review the tender documentation we have identified that the Special Procurement Notice was not published in a national newspaper, which is not in compliance with paragraph 5.23(b) of the World Bank Procurement Regulations for IPP Borrowers. This observation was identified in the following tender documentation of the Project Implementation Unit of the "Climate Resilient Water Services Project" under the Water Resources Service (the "WRS") of the Ministry of Water Resources, Agriculture and Processing Industry of the Kyrgyz Republic: - Procurement No. CREWSP/CWC1.2/RFB/2 - Tender for the renovation of the WRS Head Office and Water Center premises, and also in the following tender documentations of the Project Implementation Unit of the Department for the Development of Drinking Water Supply and Wastewater Disposals under the Ministry of Water Resources, Agriculture and Processing Industry of the Kyrgyz Republic (hereinafter – "DD DWSWD"). - Procurement No. IDA-CRWSP-CW-RFB-18-18 – Rehabilitation of the water supply system of the Kun-Chygys (Bokonbaevo) subproject, - Procurement No. IDA-CRWSP-CW-RFB-6-6 – Rehabilitation of the water supply system of the Margun subproject, - Procurement No. IDA-CRWSP-CQS-2023-2 – Selection of a consultant for the design of detailed project documentation (DPC) for rural water supply infrastructure for 5 subprojects in Baitken region (Phase II), - Procurement No. IDA-CRWSP-COMP2-IC-2023-1 – Legal consultant for capacity building of the State Institution The absence of publication in a national newspaper indicates a violation of the established procurement procedures, which increases the risk of limiting participation of potential bidders and reduces competition among tender participants. We recommend that the Project Management strengthen control over the publication of Special Procurement Notices. The Special Procurement Notice is published in the following media outlets: the State Procurement Portal, as well as the websites www.donors.kg, www.tuniksuu.kg, www.zakupki.gov.kg, www.tenders.kg, www.procurement.kg, www.water.gov.kg, and www.crwsp.kg. Additionally, the notice is directly distributed to companies from the project's database, which includes over 100 construction firms as well as suppliers of goods and services. This distribution method ensures broad outreach to all interested companies and enhances competition among tender participants. With the advancement of digital technologies, more and more people are turning to and relying on digital platforms for information. The majority of the population now accesses information through digital sources. The observation noted by the auditor will be taken into account during future tender processes.
Risk	
Recommendations	
Management's response	
Status	The auditor's recommendation has been partially implemented During the audit procedures conducted to review tender documentation, it was established that the Project Implementation Unit WRS had taken measures to implement the auditor's recommendations. During the audit procedures conducted to review tender documentation of the Project Implementation Unit DDDWSWD, we identified the following instances of non-compliance: - Procurement No. IDA-CRWSP-CW-RFB 8-8 - Rehabilitation of the Water Supply System in Kara-Bulak Village, Baitken District, - Procurement No. IDA-CRWSP-CW-RFB 4-4 - Rehabilitation of the Water Supply System in Katran Village, Leilek District, - Procurement No. IDA-CRWSP-CQS 2024-3-RT-1 - Construction Supervision Services for Drinking Water Supply System Facilities, - Procurement No. IDA-CRWSP-CQS 2025-3 - Preparation of Design and Cost Estimate Documentation and Provision of Author's Supervision Services, - Procurement No. IDA-CRWSP-COMP2-IC-2025-18 - Consultant-Trainer for Capacity Building of Local Self-Government Personnel, etc.), - Procurement No. IDA-CRWSP-IC-2025-2 - International Water Supply and Sanitation Engineer. For all of the above procurements, no publication of the Specific Procurement Notice (SPN) in a national newspaper was evidenced, which is not in compliance with Paragraph 5.23(b) of the World Bank Procurement Regulations for IPP Borrowers.

APPENDIX A

Responsibility of the Management, purposes and limitations inherent in the internal control structure

The following comments regarding responsibility of the management for the internal control structure, purposes and limitations inherent in the internal control structure are based on the International Standards on Auditing issued by the International Auditing and Assurance Standards Board (IAASB) of the International Federation of Accountants (IFAC).

Responsibility of the management

The management is responsible for development and ensuring operation of the internal control. Meeting this objective requires the management to make forecasts and estimates to determine the expected gain and costs relating to fulfillment of the policies and procedures of internal control.

Purposes

The purposes of internal control over project financial statements consist in provision of the management with sufficient but not absolute certainty in security of assets and protection from losses as a result of unauthorized use or distribution of assets and guarantee of conduct of operations on the basis of orders of the management and their proper accounting, which will ensure preparation of the project financial statements under International Public Sector Accounting Standard "Financial Reporting Under the Cash Basis of Accounting" (the "IPSAS") and the World Bank's Financial Management Sector Board's "Guidelines: Annual Financial Reporting and Auditing for World Bank Financed Activities" (the "WB Guidelines").

Limitations

Due to limitations inherent in any internal control structure, there is a possibility of mistakes and inaccuracies, which can remain undetected. Besides, forecasts with regard to any assessment or structure applicable to future periods can lose their significance due to changed conditions or decreased efficiency of the structure and functionality of the policies and procedures.